INSTRUCTIONS MANUAL















22, Rue de la Voie des Bans - 95 100 ARGENTEUIL - FRANCE
Phone +33 (0)1 30 25 83 20 - E-mail: info@bamo.fr
Fax: +33 (0)1 34 10 16 05 - http://www.bamo.eu

Safety precautions

- Fitting, wiring, initial start-up and maintenance operations must be done by trained technicians.
- All European and local rules for electrical instruments must be respected.
- The device may only be connected to intrinsically safe measuring circuits which comply with the specifications included in the technical data and on the serial plate.
- The device must be disconnected from all sources of power during installation and maintenance work.
- The device may only be operated under the conditions specified in the operating instructions.
- Respect all recommendations, for installation and mounting of Ex devices, from standards EN60079-14 and EN600079 CENELEC.
- The device should not be modified or completed with anything.
- All cables to connect the sensors must be out of any place where electrostatic risk exists.

Important:

It is necessary to follow the specific technical information corresponding to the mounting, fitting and starting up of the devices.

1. DESCRIPTION

Designed for the monitoring of hydrocarbon fluids separators, the alarm device NivOil® may be connected to 1, 2 or 3 sensors.

- Hydrocarbon layer thickness sensor to detect when the maximum thickness is reached.
- **Overfill sensor** to detect when the fluids are on the highest level; this can occurs in case of dysfunction of a filter, when a float-valve closes to prevent an overfilling, when the level of fluid is too high.
- Sludge layer sensor to alarm when maintenance is necessary.

2010 AC PROV

The 3 sensors may be connected to any input of the alarm device NivOil[®].

Any combination of the sensors can be wired. The instrument recognizes automatically the sensor type. A LED indicates the sensor type on the diagram on the front board. When an input is not wired, the LED is off.

The alarm unit NivOil® has a built-in buzzer; it is possible to disable its function by a DIP switch configuration.

The alarm unit $NivOil^{\$}$ CU/12 works with a 10 to 27 V DC power supply has a low energy consumption. It is designed for the use of a solar powered battery or any standard electric battery (consumption is 0.1 W - 12 V DC - with 3 sensors connected with one complete control cycle per hour).

The sleep mode allows optimal energy consumption. It is adjustable by modifying the frequency of control cycle (from 6 minutes up to 9 days).

A continuous control mode could be switched on when there is no limit on consumption.

All the components are ATEX certified. The sensors are for a location in zone 0 and the alarm unit corresponds to a zone 2.



2 SENSORS MOUNTING

The alarm unit NivOil® can be mounted in zone 2 of the Ex area. In case of mounting it in safe area, the Cables coming from the Ex area and going to the safe area, must pass through pressure glands or wall-ducts IP67 protection according the standard EN 60529.


Hydrocarbon fluid layer thickness sensor: Fit the sensor such as the sensor tip corresponds to the bottom of the greater layer thickness to detect. The graduated stem (5, 10 and 15 cm marks) makes the adjustment easier.

Overfilling sensor: Fit the sensor such as the ends of U probe are 2 cm under the alarming level.

Sludge layer sensor: Fit the sensor such as the ends of U probe are 2 cm under the alarming level.

Caution: The sensor may be not subject to move due to turbulences.

Do not knock the probe during mounting and maintenance operation.

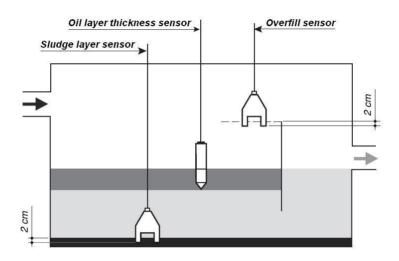

3 CONFIGURATION AND ELECTRICAL CONNECTIONS

2010 AC PROV

1/ Open the cabinet and carefully


Disconnect the ribbon cable.





Respect the standard rules concerning Ex area

Electrical circuit with intrinsic safety components may not be connected to the ground.

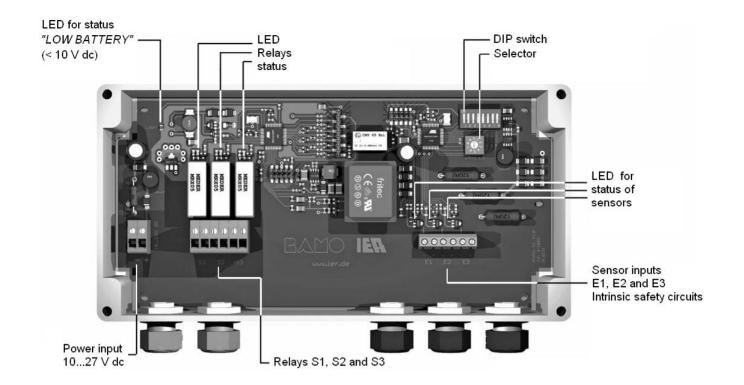

Do not connect yet the main power

DIP switch setting

	Function ON	Function OFF		
DIP 1	Audible alarm available	Audible alarm disabled		
DIP 2	Audible alarm repeats each 24 h	Audible alarm repeat function disabled		
DIP 3 DIP 4	Do not modify the setting of DIP 3 & 4, they must be in OFF position all the time			
DIP 5	Relays are NC (when the unit is powered)	Relays are NO (when the unit is powered)		
DIP 6 *)	Monitoring frequency: each 6 to 54 min	*)		
DIP 7 *)	Monitoring frequency: each 3 to 27 h	*)		
DIP 8 *)	Monitoring frequency: each 1 to 9 days	*)		

^{*):} When a DIP switch setting is wrong, the alarm unit will survey continuously (Example: none of the DIP switch 6, 7 and 8 is in ON position; or, two of them are in ON position)

Factory setting: DIP 6, 7 and 8 are in the position OFF

<u>Selector setting</u> (Duration of a monitoring cycle + sleep mode period)

	0	1	2	3	4	5	6	7	8	9
DIP 6 = ON	Continuous monitoring	6 min	12 min	18 min	24 min	30 min	36 min	42 min	48 min	54 min
DIP 7 = ON	Continuous monitoring	3 h	6 h	9 h	12 h	15 h	18 h	21 h	24 h	27 h
DIP 8 = ON	Continuous monitoring	1 day	2 days	3 days	4 days	5 days	6 days	7 days	8 days	9 days



*): When a DIP switch configuration is wrong, the alarm unit will survey continuously

Example: none of the DIP switch 6, 7 and 8 is in ON position; or, two of them are in ON position.



Monitoring modes: continuous monitoring, cyclic monitoring

The energy consumption is adjustable by modifying the duration of each monitoring cycle through the settings of the DIP switch and the selector. The monitoring frequency is adjustable from 6 minutes to 9 days. Between 2 monitoring, the alarm unit is in sleep mode (monitoring function in stand by).

When there is not a specific sleep mode period (selector on "0" and DIP 6, 7 and 8 are in ON position), the alarm unit is continuously monitoring.

When the cyclic monitoring mode is set up, each monitoring cycle begins with a self-diagnostic of sensors and detection loops in order to begin an alarm routine if necessary.

With 3 sensors connected to the alarm unit, a survey monitoring is completed in about 90 seconds.

The progress of each cycle is shown through a blinking LED (each 4 seconds approx.) on the front panel.

During the sleep mode period, by pressing the TEST button (1 second approx.) it is possible to begin directly a monitoring sequence:

- At this moment, the alarm unit begins its self-diagnostic
- In case of an alarm condition detected, it begins an alarm routine.
- After 90 seconds, the system goes back to the previous cyclic mode.

2/ Preparing the cables

Remove the external sheath as on the picture A and fit on a cable terminal ends.


Cable extension

The maximal length of an extension is 300 m.

Use our cable SK-PVC-2X1 (code number 532502) for 1 sensor ATEX classified; or, use a shielded cable with 2 wires (2x1 mm² as a minimum) certified for an ATEX classified area.

The easier way to extend the cable accordingly with ATEX rules, is to use the CET02 cable coupling, reference NivOil-JT (code number 531550), suitable to ATEX zone 0 category 1. This device is delivered with 2 WAGO connectors for fast coupling.

- Cable cross section: = 4 mm²
- Protection: IP 65 (not for a continuous immersion)
- The shield must not be connected.
- Both ends must be pressed to the limit and pressure cable glands well tightened.








3/ Connecting the sensors

Connect the sensors to the control unit NivOil® in accordance with the obligations due to Ex area, as shown on the drawing (next page).

The measuring loop, as an intrinsic safe circuit, must not be connected to the ground.

Connect the control unit to the power line.



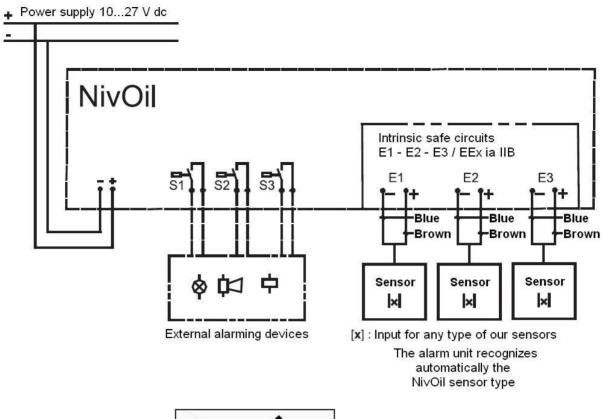

4/ Connect back **the ribbon cable** and close the cabinet



4 START-UP - TESTS

As soon as the alarm unit is powered, it begins a test of its alarming devices (LED and buzzer).

- Test of all sensors connection (short circuit and broken cable of measuring loops).
- **Detection of sensor type**, if the result is positive, the corresponding LED will light on. In case of a defect detected, the 3 LED, corresponding to this input, will be flashing. For a non connected channel, the 3 LED keep OFF.

During the first start-up, the alarm device NivOil® memorizes the type of sensor connected to each channel.

- When the TEST mode is activated, an audible signal occurs if everything is correct. (**The factory settings** are "without sensors").
- When you connect a new sensor on a free channel, the alarm device NivOil® will identify and memorize it as soon as you switch on the power.

If a sensor is removed, the corresponding 3 LED will be flashing (defect alarm).

2010 AC PROV


Proceed to a reset, pressing the **RESET** button at least 5 seconds to confirm the removal of the sensor.

• When a sensor is removed without a complete RESET, then all the LED will be flashing to alarm of this error status.


5 ALARM SYNOPTIC DIAGRAMS

For hydrocarbon fluid layer thickness and overfilling sensors (DIP3 = OFF)

Note: To avoid false alarms a 10 seconds delay is factory set up.

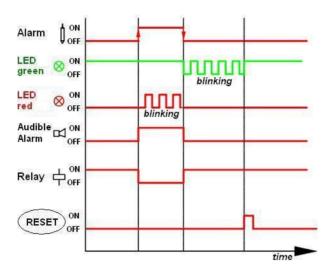

Event 1: Waves on the fluid surface.
Status alarm is ON and resets by itself.
The green LED is then reset.

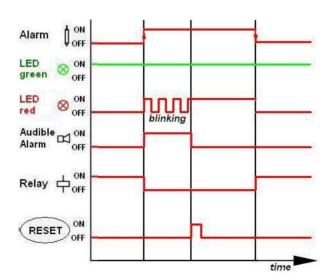


Event 2: Status alarm is ON and keeps on.

à Press the "RESET" button, to reset the alarm.

The red LED shuts OFF when the alarm origin disappears.

page 7

2010 AC PROV



Event 3: Alarm have been on reset, but defect origin still exists.


à After 24 hours the alarm set ON again and the red LED is blinking

Repeat alarm function

The alarm repeat function is disabled or activated with the DIP switch 2.

When DIP 2 is in position "ON" the alarm will repeat again 24 hours after the first event, if the alarm event is not corrected.

For sludge probe (DIP3 = OFF)

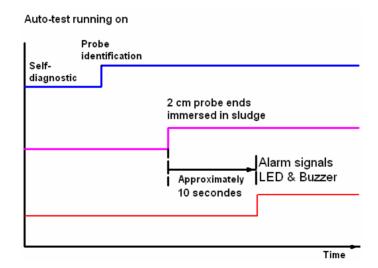

The test could be completed with the probe outside the separator and totally immersed in water. After the self diagnostic sequence, the control unit recognized the sludge probe and will:

- Alarming when the probe ends are in the air, Or/and
- When probe ends are inside 1 cm or 2 cm inside sludge (sand, soils etc.).

The alarm synoptic diagrams for the sludge probe are identical to the diagrams for hydrocarbon fluid layer thickness and overfilling sensors



6 ALARM SIGNALS

When the unit starts up and after the self diagnostic:

Defect	Signal
	⇒ All the green LED are blinking
Short circuit in the measuring loop	
	⇒ Relays are OFF
	⇒ All the LED are shut OFF
Measuring loop cable is broken	⇒ Audible alarm is shut OFF
	⇒ Relays are OFF
Wrong polarity on sensor wiring	
	⇒ Relays are OFF

When the device is operating during MONITORING MODE

Sensor status Alarm status		Signals			
Without defect	No alarm	Green LED (on corresponding function)	⇒ Light on		
Defect corrected, not reset	No alarm	All green LED (on corresponding channel)	⇒ Blinking + Buzzer		
Reset defect, not corrected No alarm		All green LED (on corresponding channel)	∌ Blinking		
Without defect	Not reset alarm	Red LED (on corresponding channel)	⇒ Blinking + Buzzer		
Without defect		Green LED (on corresponding function)	⊕ Light on		
Without defect	Reset alarm, not corrected	Red LED (on corresponding channel)	⇒ Light on		
Without defect		Green LED (on corresponding function)	⊕ Light on		

When the device is operating during SLEEP MODE

2010 AC PROV


Sensor status Alarm status		Signals				
Without defect	No alarm	Green LED (on corresponding function)	⇒ Blinking			
Defect corrected, not reset	No alarm	All green LED (on corresponding channel)	∌ Doubled blinking			
Reset defect, not corrected No alarm		All green LED (on corresponding channel)	⇒ Doubled blinking			
Without defect	Not reset alarm	Red LED (on corresponding channel)	⇒ Doubled blinking			
Without defect		Green LED (on corresponding function)	∌ Blinking			
Without defect	Reset alarm, not corrected	Red LED (on corresponding channel)	⇒ Blinking			
		Green LED (on corresponding function)	⇒ Blinking			

7 AUDIBLE ALARM

To disable the audible alarm use the DIP switch 1 inside the cabinet. Therefore the alarm status is indicated by the LED.



CAUTIONDisconnect from the main power Before opening the cabinet



8 TEST MODE

The alarm unit NivOil® could run a self-diagnostic sequence each time you need to test the system:

- Press the "TEST" button (at least 1 second)
- ⇒ Self-diagnostic routine begins, LED are blinking (LED test)
- ⇒ The buzzer is switched ON (Audible alarm test)
- ⇒ Check out of sensor parameters (test of sensor type, short-circuit, broken cable)

Positive test: Corresponding LED are ON

Negative test: Corresponding green LED are blinking

9 MAINTENANCE

The alarm device and its sensors do not require any maintenance operation in normal operation.

After an alarm occurred, the sensors must be cleaned as the separator is drained.

To clean out a sensor use a wetted rag, with a house cleaning and degreasing liquid.

10 PRECAUTION

Hydrocarbon fluid layer thickness sensor

Thickness detection cannot be performed properly in contact with existing chemical substances such as emulsifiers and surface active wetting agents (detergent).

The sensor must be in contact only with liquids compatible with polyethylene.

2010 AC PROV



11 TECHNICAL FEATURES

NivOil® CU/12 - alarm unit

Main power supply: 10...27 V dc

Power consumption: 0.1 W / 12 V dc (with 3 sensors operating, 1 monitoring per hour)

Housing protection: IP65, according EN 60529

Temperature limits: -20...+60°C

Sensor inputs 3 inputs with automatic sensor type detection for:

Hydrocarbon fluids layer thickness,

Overfill level, Sludge layer level

Monitoring: The alarm unit has a self-diagnostic of measuring loop,

for short circuit or a broken cable detection.

Display and signals: 1 function signal LED (green) on each channel

1 alarm signal LED (red) on each channel

Built-in audible alarm, disabled by DIP switch configuration

Front panel: 2 push buttons for diagnostic test and alarm clearance

Outputs: 3 relay outputs, 250 V ac, 0.5 A as a maximum, potential free change over contacts

Ex protection class: $\langle E_x \rangle$ II 3 (1) G Ex nAC [ia Ga] IIB / IIA T4 Gc

ATEX Certificate: BVS 10 ATEX E 011

CE Marks According to EC directives, Low Voltage Guidelines: RL 2006/95/EG & RL93/68/EWG,


EMV Guidelines: RL 89/336/EWG (EN 61326)

ATEX RL 94/9/EG (ATEX 95)

2010 AC PROV

EN 60079-0 (General requirements) - EN 60079-11 (Intrinsic safety) - and

EN 60079-26 (Group II; category 1G)



- (1) The alarm Unit NivOil® CU/12 may be installed in zone 2
- (2) For intrinsic safety parameters [U_O, I_O, P_O and C_O, L_O] see the details in the ATEX Certificate.

NivOil®-OP/10, Hydrocarbon fluid layer thickness sensor (Only for use with an alarm device NivOil®)

Sensor type: Capacitive, high frequency

Wetted parts: Antistatic PE stem; Stainless steel end probe

Cable: Elastomer resistant to oils and hydrocarbon fluids, blue colour;

wires 2x 1mm2, connections to the alarm device NIVOIL on screw connectors; 10 m long cable (other lengths on request –


maximal length is 300 m)

Protection: IP68 acc. EN 60529

Temperature limits: -20...+60°C

Ex protection class: (Ex) II 1 G Ex ia IIB T4 (intrinsic safety)

ATEX certificate: BVS 07 ATEX E 091 X



NivOil®-HPS/10, overfilling sensor (Only for use with an alarm device NivOil®)

Sensor type: Ultrasonic detection type

Wetted parts: PVC

Cable: Elastomer resistant to oils and hydrocarbon fluids, blue colour;

wires 2x 1mm2, connections to the alarm device NIVOIL on screw connectors; 10 m long cable (other lengths on request –


maximal length is 300 m)

Dimensions: 145 x 90 x 25 mm Protection: IP68 acc. EN 60529

Temperature limits: -20...+60°C

Ex protection class: $\langle \mathcal{E}_{x} \rangle$ II 1 G Ex ia IIB T4 (intrinsic safety)

ATEX certificate: BVS 09 ATEX E 021X



NivOil® -SP/10, Sludge layer sensor (Only for use with an alarm device NivOil®)

Sensor type: Ultrasonic detection type

Wetted parts: PVC

msa531-02

Cable: Elastomer resistant to oils and hydrocarbon fluids, blue colour;

wires 2x 1mm2, connections to the alarm device NIVOIL on screw connectors; 10 m long cable (other lengths on request –

maximal length is 300 m)


Dimensions: 145 x 90 x 25 mm Protection: IP68 acc. EN 60529

Temperature limits: -20...+60°C

Ex protection class: $\langle E_x \rangle$ II 1 G Ex ia IIB T4 (intrinsic safety)

ATEX certificate: BVS 09 ATEX E 021X

2010 AC PROV



page 12

- (1) These sensors may be installed in zone 0
- (2) For intrinsic safety parameters [U_i, I_i, P_i and C_i, L_i] see the details in the ATEX Certificate for each sensor.

